### Field Tests on Actual Microgrids

Highlight results from the case of Gaidouromantra site, Kythnos Island Participants: IWES, SMA, NTUA, ANCO, CRES

Author: Stathis Tselepis, Affiliation: CRES stselep@cres.gr







# Description of the microgrid 1





The microgrid in Gaidouromantra, Kythnos was installed in 2001, in the framework of two European projects (PV-MODE, JOR3-CT98-0244 and MORE, JOR3CT98-0215).

The microgrid in Gaidouromantra is autonomous. It is composed of a 3-phase low voltage grid, formed by battery inverters. The grid is composed of the overhead power lines and a communication cable running in parallel to serve the monitoring and control needs.

Total generation capacity: 3X5 kVA

<u>Technologies involved</u>: PV generatos, Battery storage, Diesel genset, intelligent load controllers


Maximum demand: 12 kVA

No of clients: 12 vacation houses



## Description of the microgrid 2



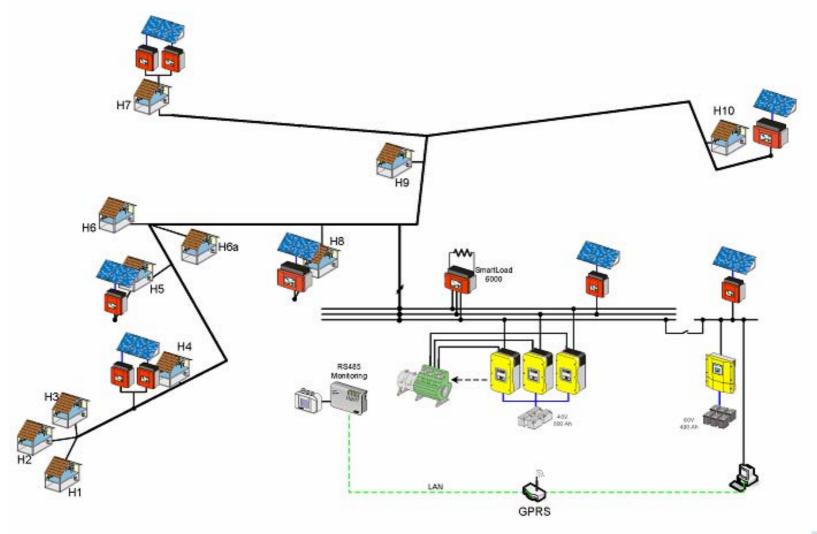

#### Gaidouromantra microgrid, Kythnos island



Optimization of the operation in islanded mode using agent based control of non-critical loads at several houses

- The primary goal can be separated in two sections the technical and the electrical:
- The technical goal was to install, check and optimize a quite complex system in a real environment
- The electrical goal included the minimization of the diesel generator usage and also the operation of loads during hours with PV energy excess



## Objectives of the demo case 2



- Upgrades of the power converters under the More-Microgrids project with new ones capable to deal with the strenuous conditions of islanded mode control were realized
- Performance monitoring of the Gaidouromantra microgrid
- Implementation of an agent-based Load Controller system that can be used to monitor the status of the power line and take measurements of Voltage, Current and Frequency.



Inside System House







House 5



House 7



House 4





A monitoring system for distributed generators and loads in the microgrid was designed, installed and operated

Provided:

- Possibility for early detection of components malfunction
- Enhancement of reliability, performance and safety for power supply of customers
- Remote supervision of the microgrid system
- A data base for performance data was design and implemented




## Highlight results (Performance monitoring of Gaidouromantra microgrid



CRES 7

#### **Power Quality Monitoring**

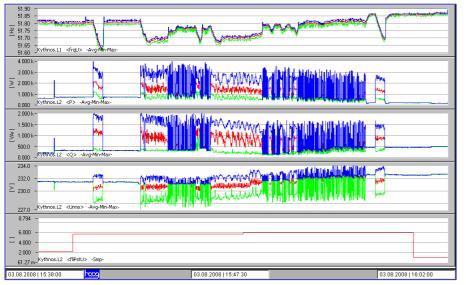

Example of monitoring of frequency, voltage flicker, active and reactive power



Power quality analyser

Power quality evaluation according to EN50160 for a week in August 2008

• Grid frequency operation window was violated due to fact that frequency is used for energy management, PV inverter derating (>51Hz) and house disconnection (<49 Hz).


• Higher values for voltage flicker for short times due to a pump operation.

- Voltage Harmonic U9 above threshold due to a cyclic load (refrigerator)
- Voltage Harmonic U6 above the limit, when the PV inverters were operating in de-rating mode.





#### The daily performance ratio was ranging from 0.2 – 0.6

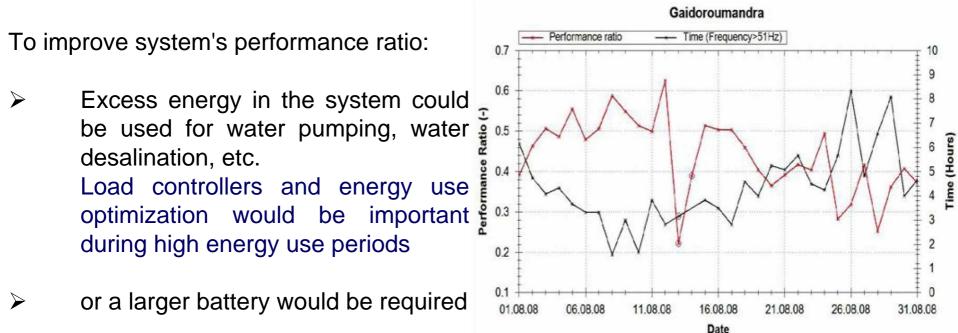

Performance ratio and time duration with frequency over 51 Hz



#### **Results**



CRES 9

- Improvements and upgrades of the microgrid with the latest technology power devices
- Energy performance monitoring campaign: Microgrid specific standards for power quality monitoring will be needed (islanded operation)
- Good and reliable Agent based Intelligent Load Controller operation
- Most of the citizens accepted the system well and were very cooperative during the tests
- Capability of simulating static and dynamic operation of the microgrid
- Validation of simulation tests of the microgrid with measured data of the real system operation



The following ideas may be the foundation of a future R&D project in Gaidouromantra, Kythnos Island:

- Continuation of the monitoring and supporting the maintenance and operation of the microgrid
- Development of the required safety, protection measures, communication and control of an active (bi-directional) Low voltage to Medium voltage transformer.
- Interconnection of the Gaidouromantra microgrid with the Kythnos island Medium voltage grid and optimization of the microgrid operation, transitions between islanded and inter-connected mode and use of the discarded PV energy.

